

SECTION


NOTES:

ASPHALT PAVERS SHALL BE OF THE DIMENSION AND COLOR AS SHOWN IN THE SPECIFICATIONS.

THE UNIT PAVERS SHALL BE LAID IN A PATTERN.

ASPHALT PAVERS ON CONCRETE BASE

Not to Scale

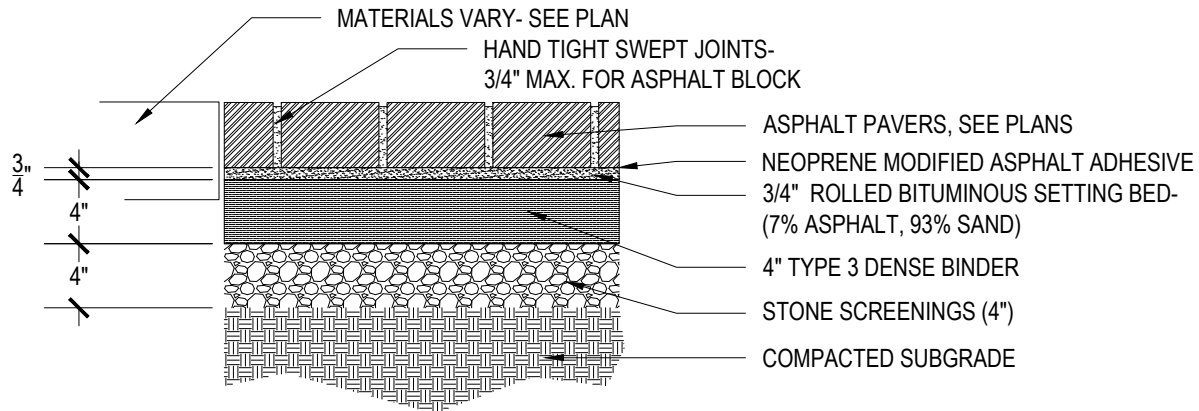


SECTION

NOTES:


ASPHALT PAVERS SHALL BE OF THE DIMENSION AND COLOR AS SHOWN IN THE SPECIFICATIONS.

THE UNIT PAVERS SHALL BE LAID IN A PATTERN.




Asphalt Pavers on Asphalt Base

Not to Scale

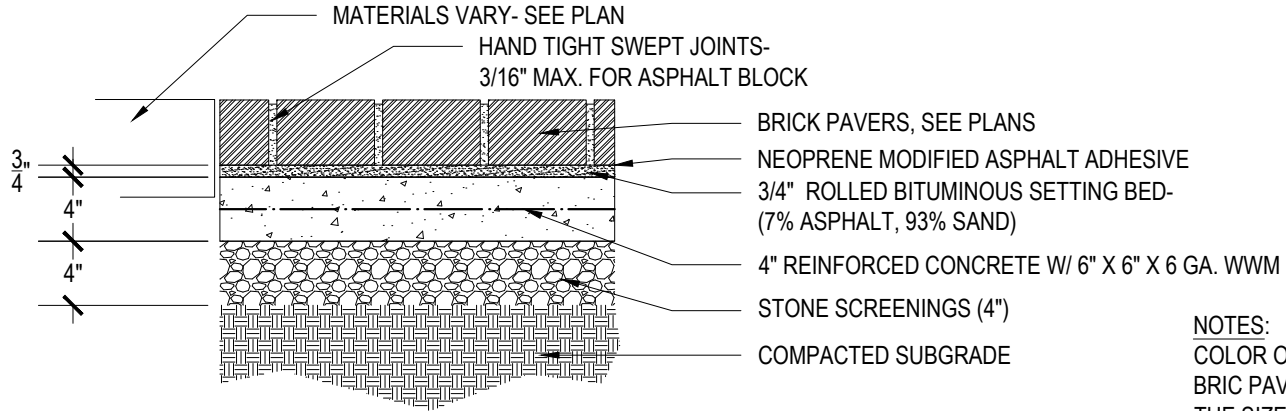


SECTION



PAVING PATTERN


NOTES:

COLOR OF BRICK SHALL BE
 BRIC PAVERS SHALL BE LAID IN A PATTERN.
 THE SIZE OF THE BRICK SHALL BE THICK.
 BRICK PAVERS SHALL BE OF THE DIMENSION AND
 COLOR SHOWN IN THE SPECIFICATION.



Brick Pavers on Concrete Base

Not to Scale

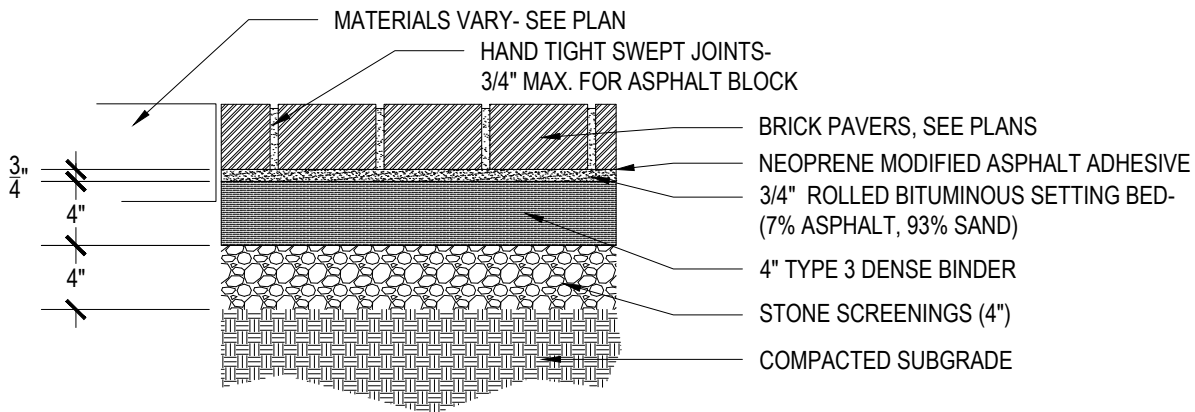

SECTION

NOTES:

ASPHALT PAVERS SHALL BE OF THE DIMENSION AND COLOR AS SHOWN IN THE SPECIFICATIONS.

THE UNIT PAVERS SHALL BE LAID IN A PATTERN.

THE SIZE OF THE PAVERS SHALL BE THICK.

Brick Pavers on Asphalt Base

Not to Scale

NOTES



GRANITE BLOCK PAVERS MAY BE CLEAN USED PAVING BLOCKS SALVAGED FROM THIS PROJECT. ADDITIONAL PAVERS AND/OR ALL NEW PAVERS, IF REQUIRED, SHALL BE SUPPLIED BY CONTRACTOR.
 FLEXIBLE BASE

GRANITE BLOCK PAVERS SHALL BE SET ON A 2" THICK CLEAN FINE SAND SETTING BED, FLUSH WITH SURROUNDING PAVEMENT. SPACES BETWEEN THE BLOCKS MAY VARY BETWEEN A MINIMUM OF 1/4" TO A MAXIMUM OF 1". AFTER ALL THE GRANITE BLOCK PAVERS HAVE BEEN SET, CLEAN FINE SAND SHALL BE SWEEPED INTO THE JOINTS, LOCKING THE JOINTS TOGETHER. AFTER SWEEPING, THE ENTIRE AREA SHALL BE GENTLY MISTED WITH WATER. THIS ENTIRE PROCESS SHALL THEN BE REPEATED UNTIL NO FURTHER SETTLING OCCURS.

RIGID BASE

GRANITE BLOCK PAVERS SHALL BE SET ON A 2" THICK DRY MIX SETTING BED, CONSISTING OF EQUAL PARTS FINE SAND AND CEMENT. PAVERS SHALL BE LAID FLUSH WITH SURROUNDING PAVEMENT.

SPACES BETWEEN THE BLOCKS MAY VARY BETWEEN A MINIMUM OF 1/4" TO A MAXIMUM OF 1". AFTER ALL THE GRANITE BLOCKS HAVE BEEN SET, A DRY MIX OF FINE SAND AND CEMENT SHALL BE SWEEPED INTO THE JOINTS, LOCKING THE JOINTS TOGETHER. AFTER SWEEPING, THE ENTIRE AREA SHALL BE GENTLY MISTED WITH WATER. THIS ENTIRE PROCESS SHALL THEN BE REPEATED UNTIL NO FURTHER SETTLING OCCURS.

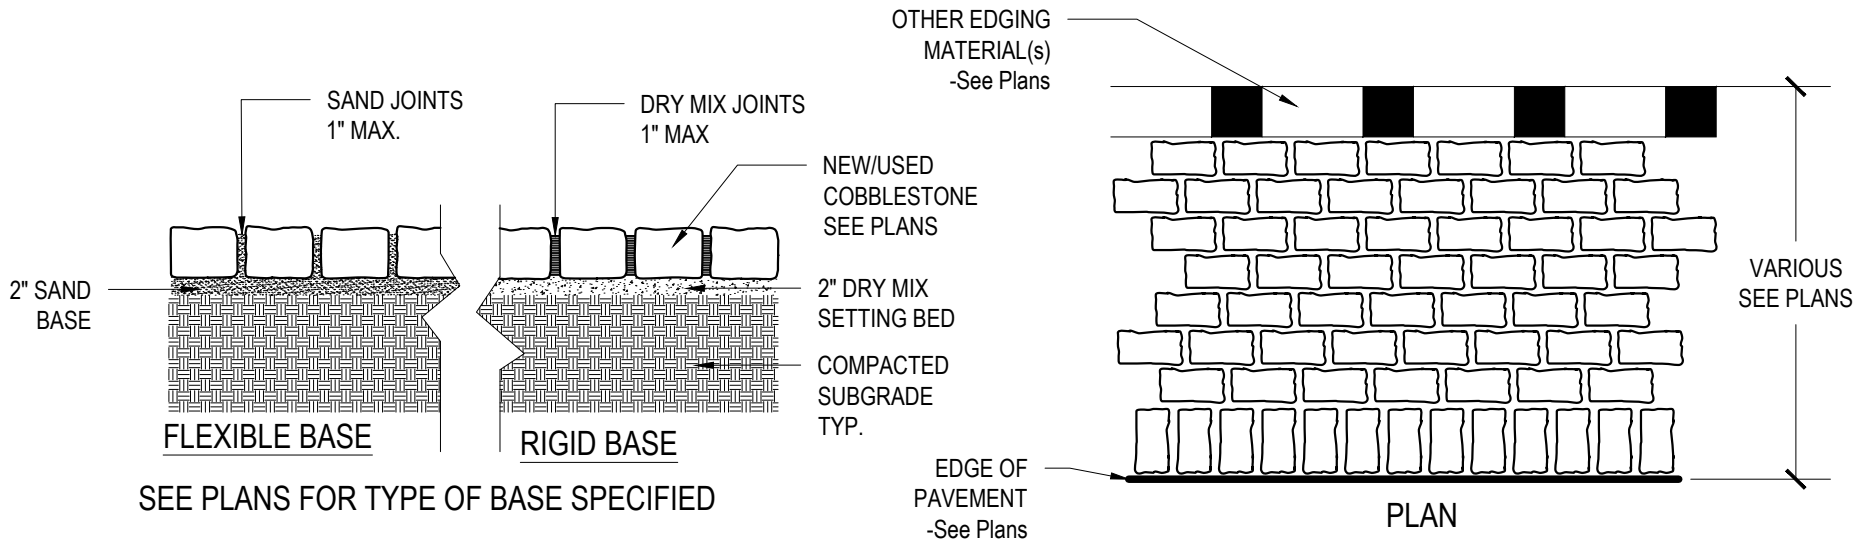

GRANITE BLOCK PAVERS ON FLEXIBLE OR RIGID BASE

NOTES


GRANITE BLOCK PAVERS MAY BE CLEAN USED PAVING BLOCKS SALVAGED FROM THIS PROJECT. ADDITIONAL PAVERS AND/OR ALL NEW PAVERS, IF REQUIRED, SHALL BE SUPPLIED BY THE CONTRACTOR.

FLEXIBLE BASE



GRANITE BLOCK PAVERS SHALL BE SET ON A 2" THICK CLEAN FINE SAND SETTING BED, FLUSH WITH SURROUNDING PAVEMENT. SPACES BETWEEN THE BLOCKS MAY VARY BETWEEN A MINIMUM OF 1/4" TO A MAXIMUM OF 1". AFTER ALL THE GRANITE BLOCK PAVERS HAVE BEEN SET, CLEAN FINE SAND SHALL BE SWEEPED INTO THE JOINTS, LOCKING THE JOINTS TOGETHER. AFTER SWEEPING, THE ENTIRE AREA SHALL BE GENTLY MISTED WITH WATER. THIS ENTIRE PROCESS SHALL THEN BE REPEATED UNTIL NO FURTHER SETTLING OCCURS.

RIGID BASE


GRANITE BLOCK PAVERS SHALL BE SET ON A 2" THICK DRY MIX SETTING BED, CONSISTING OF EQUAL PARTS FINE SAND AND CEMENT, FLUSH WITH SURROUNDING PAVEMENT. SPACES BETWEEN THE BLOCKS MAY VARY BETWEEN A MINIMUM OF 1/4" TO A MAXIMUM OF 1". AFTER ALL THE GRANITE BLOCKS HAVE BEEN SET, A DRY MIX OF FINE SAND AND CEMENT SHALL BE SWEEPED INTO THE JOINTS, LOCKING THE JOINTS TOGETHER. AFTER SWEEPING, THE ENTIRE AREA SHALL BE GENTLY MISTED WITH WATER. THIS ENTIRE PROCESS SHALL THEN BE REPEATED UNTIL NO FURTHER SETTLING OCCURS.

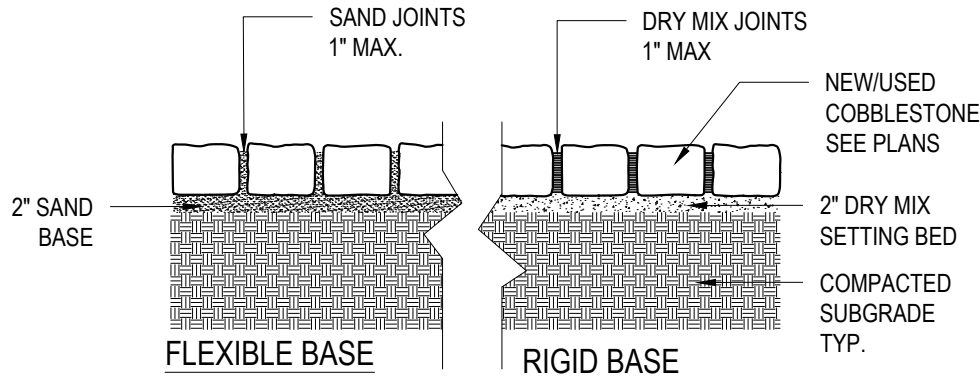

SEE PLANS FOR TYPE OF BASE SPECIFIED

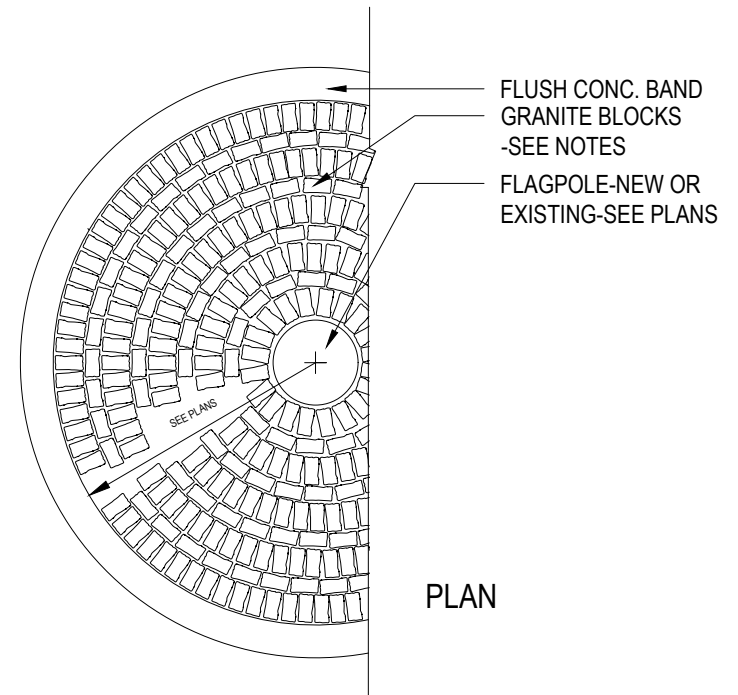

Granite Block Pavement Around Flagpole Area

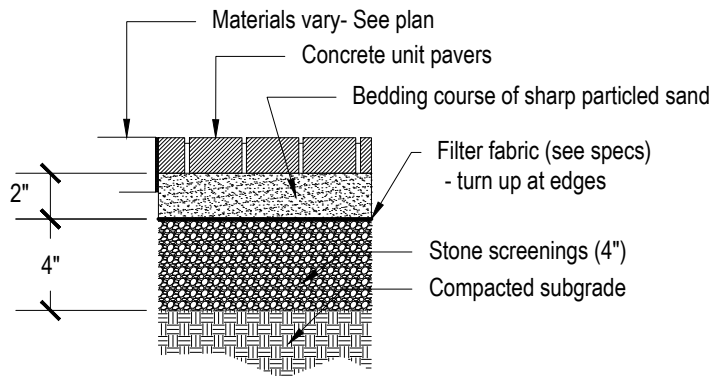

NOTES:

PRECAST INTERLOCKING CONCRETE UNIT PAVERS SHALL HAVE A COMPRESSIVE STRENGTH OF GREATER THAN 8000 PSI, AND SHALL MEET THE REQUIREMENTS SET FORTH IN ASTM C936.

PIGMENT IN CONCRETE PAVERS SHALL CONFORM TO ASTM C979.

EDGE STONES TO BE MORTERED IN PLACE ON 2" OF CONCRETE. STONE SCREENINGS SHALL NOT EXCEED $\frac{1}{4}$ " DIAMETER.

THE CONCRETE UNIT PAVERS SHALL BE _____

THE UNIT PAVERS SHALL BE LAID IN A _____ PATTERN.


THE COLOR OF THE PAVERS SHALL BE _____

THE UNIT PAVERS SHALL BE CAREFULLY LAID ON THE SAND TO ENSURE JOINTS ARE NO MORE THAN $\frac{1}{8}$ ". WHERE REQUIRED, CUT PAVING STONES WITH APPROVED CUTTER TO FIT NEATLY AND ACCURATELY WITHOUT DAMAGING EDGES. SAND SHALL BE SWEEPED INTO JOINTS.

THE DEPTH OF THE UNIT PAVERS = $2 \frac{0000}{0000}$ ".

CONCRETE UNIT PAVERS ON FLEXIBLE BASE

Not to Scale

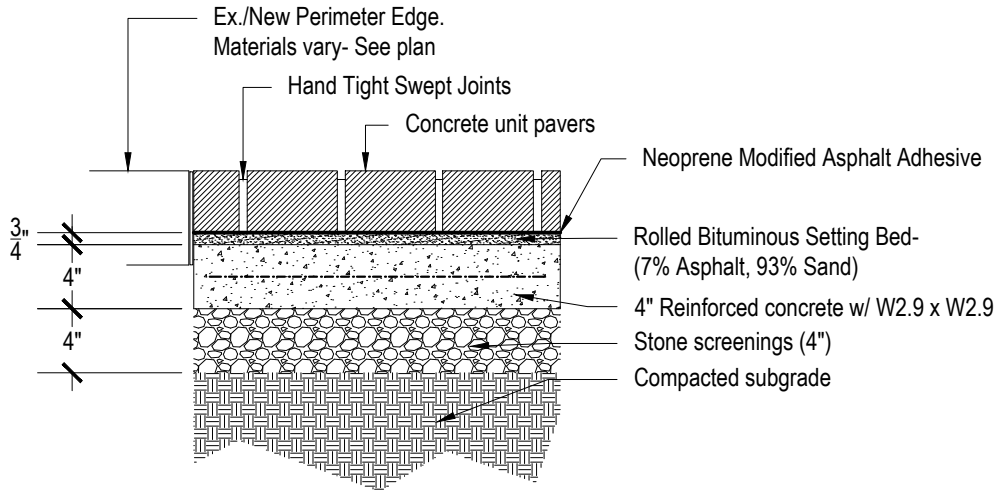

NOTES:

PRECAST UNIT PAVERS SHALL HAVE A COMPRESSIVE STRENGTH OF GREATER THAN 8000 psi, AND SHALL MEET THE REQUIREMENTS SET FORTH IN ASTM C936. PIGMENT IN CONCRETE PAVERS SHALL CONFORM TO ASTM C979.


THE UNIT PAVERS SHALL BE CAREFULLY LAID TO ENSURE JOINTS ARE NO MORE THAN $\frac{1}{8}$ ". WHERE REQUIRED, PAVING STONES SHALL BE CUT WITH AN APPROVED CUTTER TO FIT NEATLY AND ACCURATELY, WITHOUT DAMAGING EDGES. SAND SHALL BE SWEEPED INTO JOINTS.

THE DEPTH OF THE UNIT PAVERS SHALL BE $2\frac{3}{8}$ ".


STONE SCREENINGS SHALL NOT EXCEED $\frac{1}{4}$ " DIAMETER. THE CONCRETE UNIT PAVERS SHALL MATCH EXISTING. THE UNIT PAVERS SHALL MATCH EXISTING PATTERN. THE COLOR OF THE PAVERS SHALL MATCH EXISTING.

CONCRETE UNIT PAVERS ON RIGID BASE

Not to Scale




PATTERN

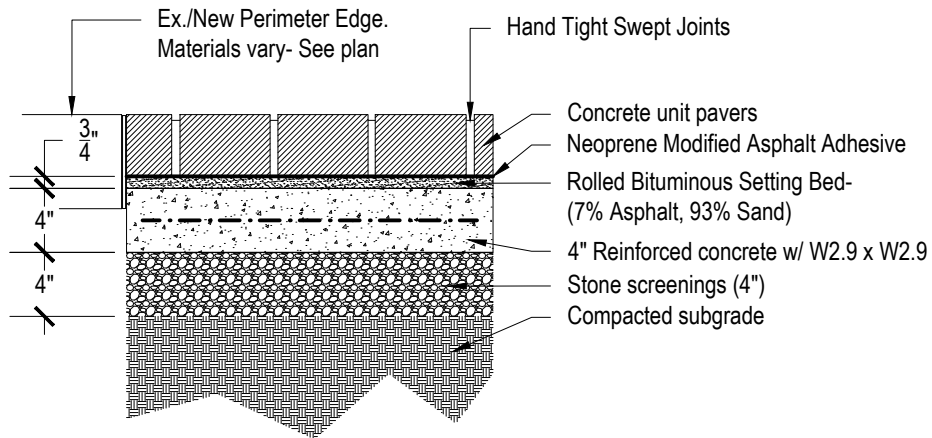


NOTES:

PRECAST UNIT PAVERS SHALL HAVE A COMPRESSIVE STRENGTH OF GREATER THAN 8000 psi, AND SHALL MEET THE REQUIREMENTS SET FORTH IN ASTM C936. PIGMENT IN CONCRETE PAVERS SHALL CONFORM TO ASTM C979. THE UNIT PAVERS SHALL BE CAREFULLY LAID TO ENSURE JOINTS ARE NO MORE THAN $\frac{1}{8}$ ". WHERE REQUIRED, PAVING STONES SHALL BE CUT WITH AN APPROVED CUTTER TO FIT NEATLY AND ACCURATELY, WITHOUT DAMAGING EDGES. SAND SHALL BE SWEEPED INTO JOINTS. THE DEPTH OF THE UNIT PAVERS SHALL BE $2\frac{3}{8}$ ". STONE SCREENINGS SHALL NOT EXCEED $\frac{1}{4}$ " DIAMETER. THE CONCRETE UNIT PAVERS SHALL BE _____ . THE UNIT PAVERS SHALL BE LAID IN A _____ PATTERN. THE COLOR OF THE PAVERS SHALL BE _____ .



Concrete Unit Pavers on Rigid Base

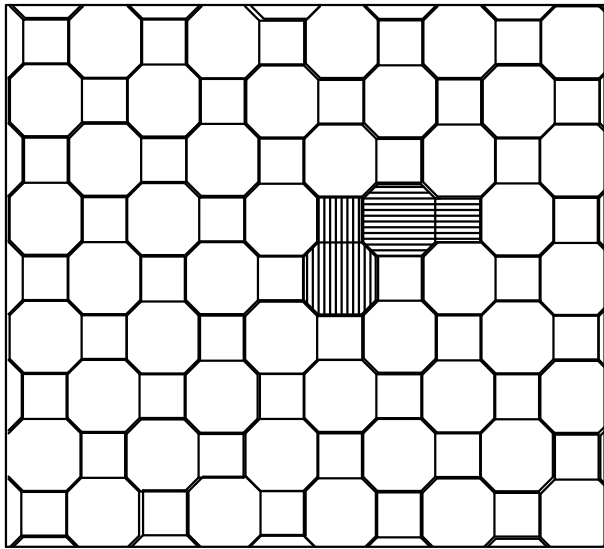

PATTERN

NOTES:

PRECAST UNIT PAVERS SHALL HAVE A COMPRESSIVE STRENGTH OF GREATER THAN 8000 psi, AND SHALL MEET THE REQUIREMENTS SET FORTH IN ASTM C936. PIGMENT IN CONCRETE PAVERS SHALL CONFORM TO ASTM C979.

THE UNIT PAVERS SHALL BE CAREFULLY LAID TO ENSURE JOINTS ARE NO MORE THAN $\frac{1}{8}$ ". WHERE REQUIRED, PAVING STONES SHALL BE CUT WITH AN APPROVED CUTTER TO FIT NEATLY AND ACCURATELY, WITHOUT DAMAGING EDGES. SAND SHALL BE SWEEPED INTO JOINTS. THE DEPTH OF THE UNIT PAVERS SHALL BE $2\frac{3}{8}$ ".


STONE SCREENINGS SHALL NOT EXCEED $\frac{1}{4}$ " DIAMETER.

THE CONCRETE UNIT PAVERS SHALL BE "UNIDECOR."


THE UNIT PAVERS SHALL BE LAID IN A HERRINGBONE PATTERN.

THE COLOR OF THE PAVERS SHALL BE TERRA COTTA.

FOR AVED BERM DETAIL, SEE

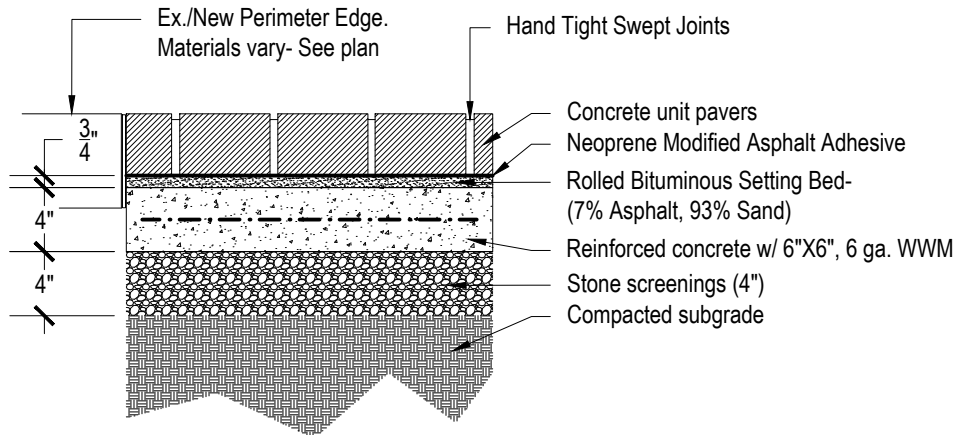

THE UNIT PAVERS SHALL BE AS MANUFACTURED BY:
 UNILOCK NEW YORK
 51 INTERNATIONAL BLVD.
 BREWSTER, NY 10509
 (845) 278-6700
 OR APPROVED EQUAL



Concrete Unit Pavers on Rigid Base