


NOTE- IF THE ENTRANCE/EXIT MUST BE "ACCESSIBLE", THEN THE MAXIMUM SLOPE ALLOWED FOR ALL ASPECTS OF THE RAMP SHALL BE 1:12. IF THE ENTRANCE/EXIT IS NOT "ACCESSIBLE", THEN THE MAX. SLOPE SHALL BE 1:10.

SEE DETAIL FOR REBAR SCHEDULE WAL-11

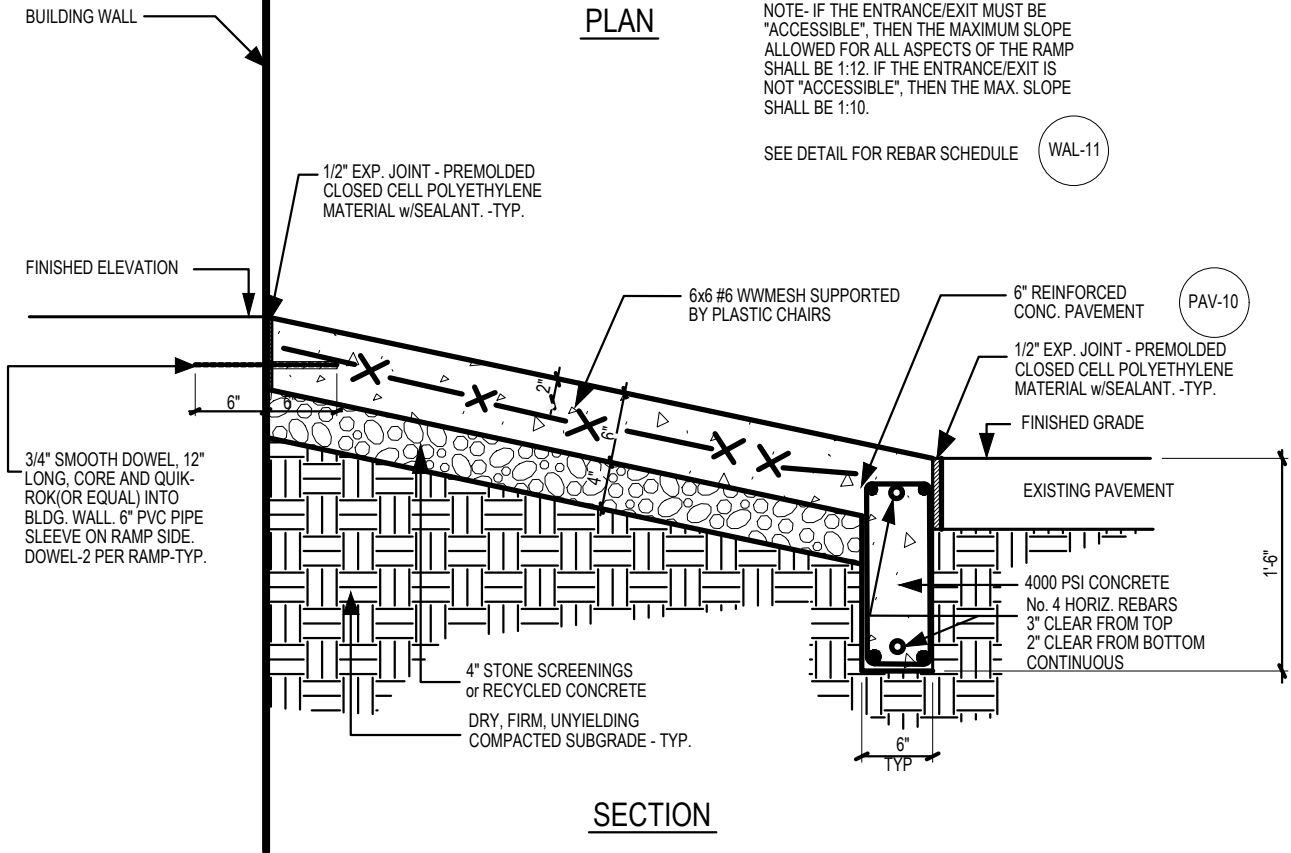

3/4" SMOOTH DOWEL, 12" LONG, CORE AND QUIK-ROK (OR EQUAL) INTO BLDG. WALL. 6" PVC PIPE SLEEVE ON RAMP SIDE. DOWEL-2 PER RAMP-TYP.

PAV-10

4000 PSI CONCRETE
No. 4 HORIZ. REBARS
3" CLEAR FROM TOP
2" CLEAR FROM BOTTOM
CONTINUOUS



New York City Housing Authority
Capital Projects Division
Design Department
90 Church Street, 10th Floor
New York, NY 10007

Title:
**CONCRETE RAMP AT ENTRANCE
6" MAX HEIGHT**

Contract Name:
GROUNDS REQUIREMENT

Contract No.
GD XXXXXXX
Drawn by:
G. SOUKAS
Checked by:
K. MARSHAL

Scale:
Not to Scale
Date:
January 2017

Drawing No.
RAM- 02